

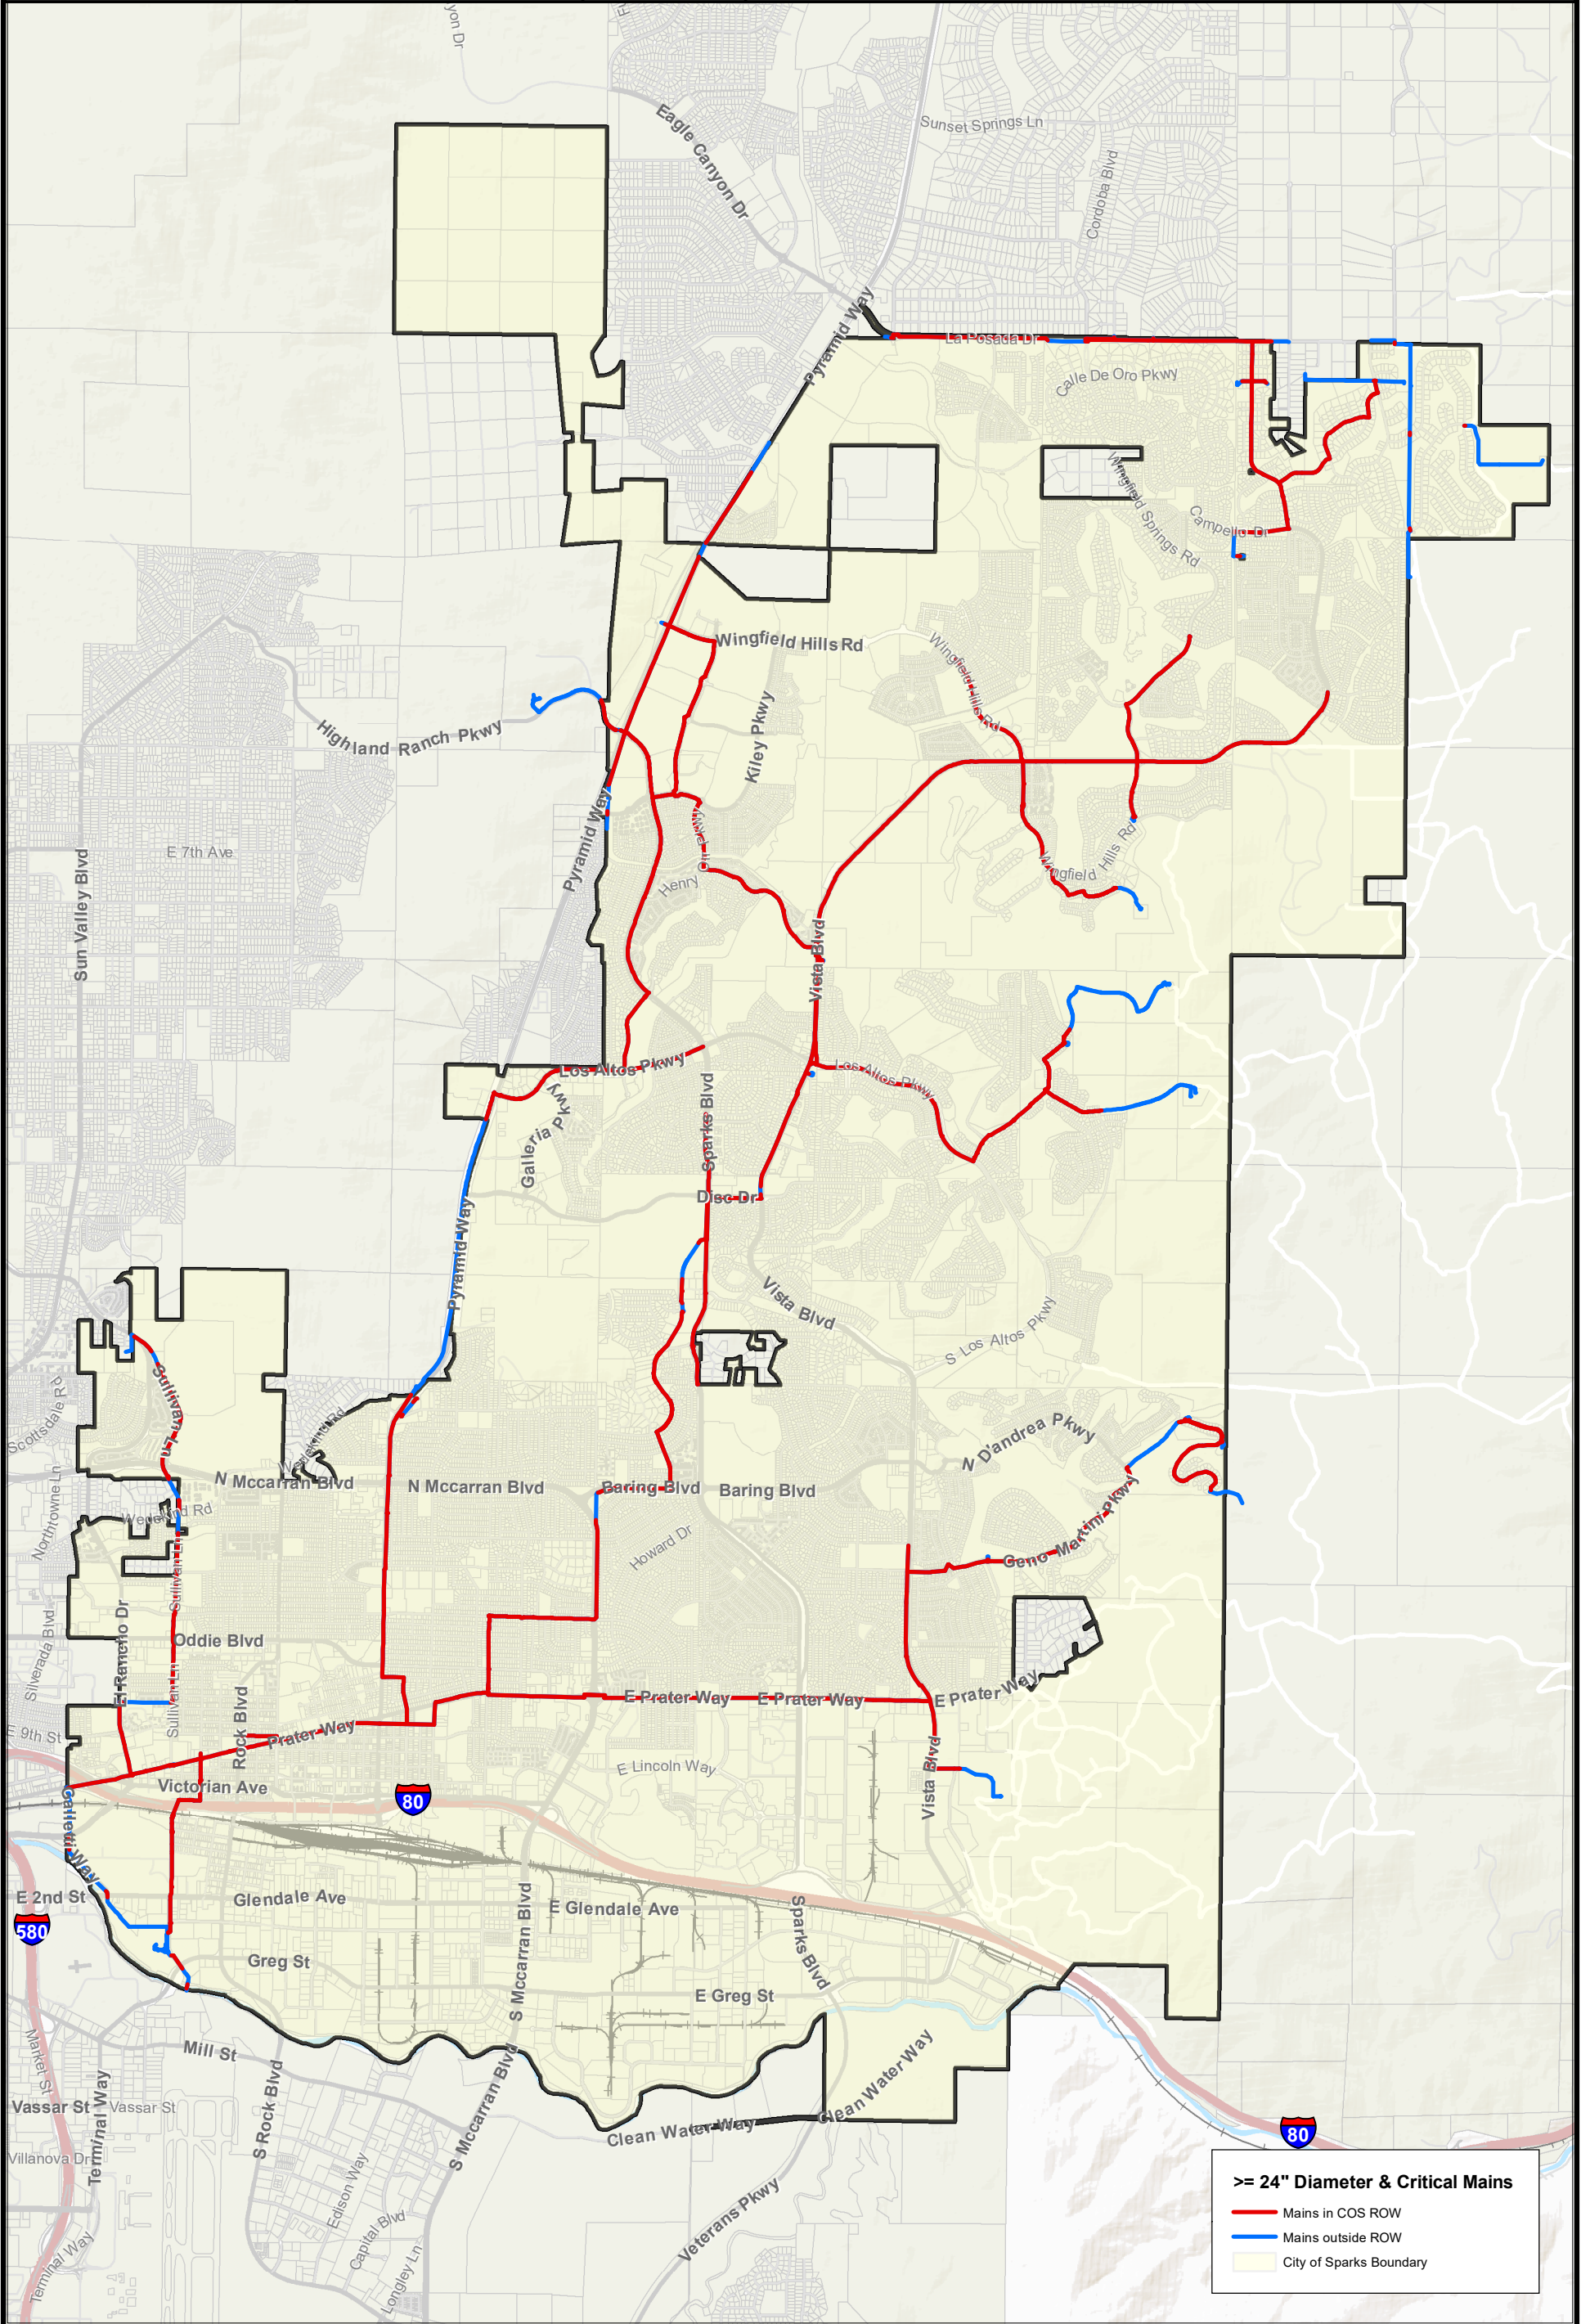


Exhibit A: COS Water Mains

≥ 24" Diameter & Mains of Critical Importance

1" equals 3,960'

06/17/2019



≥ 24" Diameter & Critical Mains

- Mains in COS ROW
- Mains outside ROW
- City of Sparks Boundary